


**SUGGESTED NETWORK CONNECTIVITY FOR FOR SPEECH & DATA APPLICABLE TO
132KV BIDANASI-CHODWAR LILO AT CDA,BRAJBHARIPURTHROUGH OPGW SCHEME- I**



GENERAL MANAGER
TELECOMMUNICATION

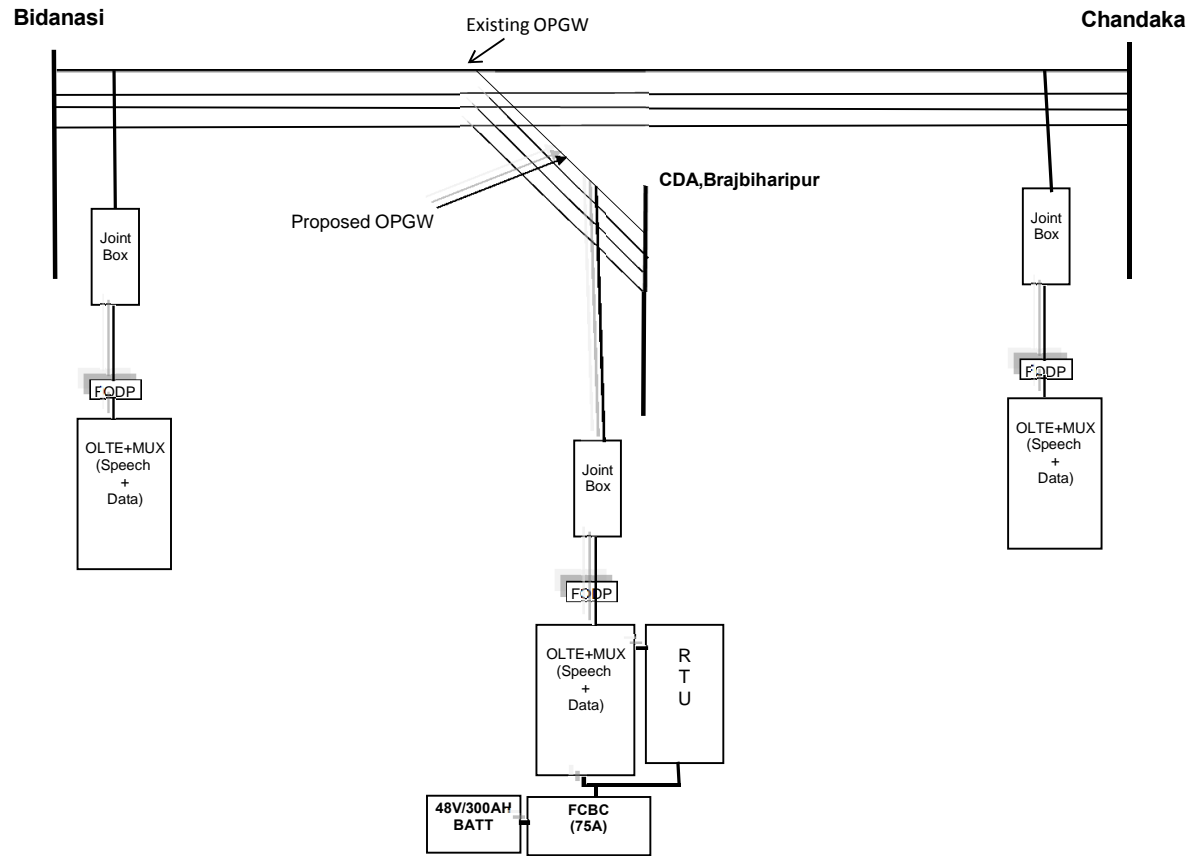