



SCHEMATIC LAYOUT FOR PROVISION OF SPEECH & DATA APPLICABLE TO 132KV GHENS

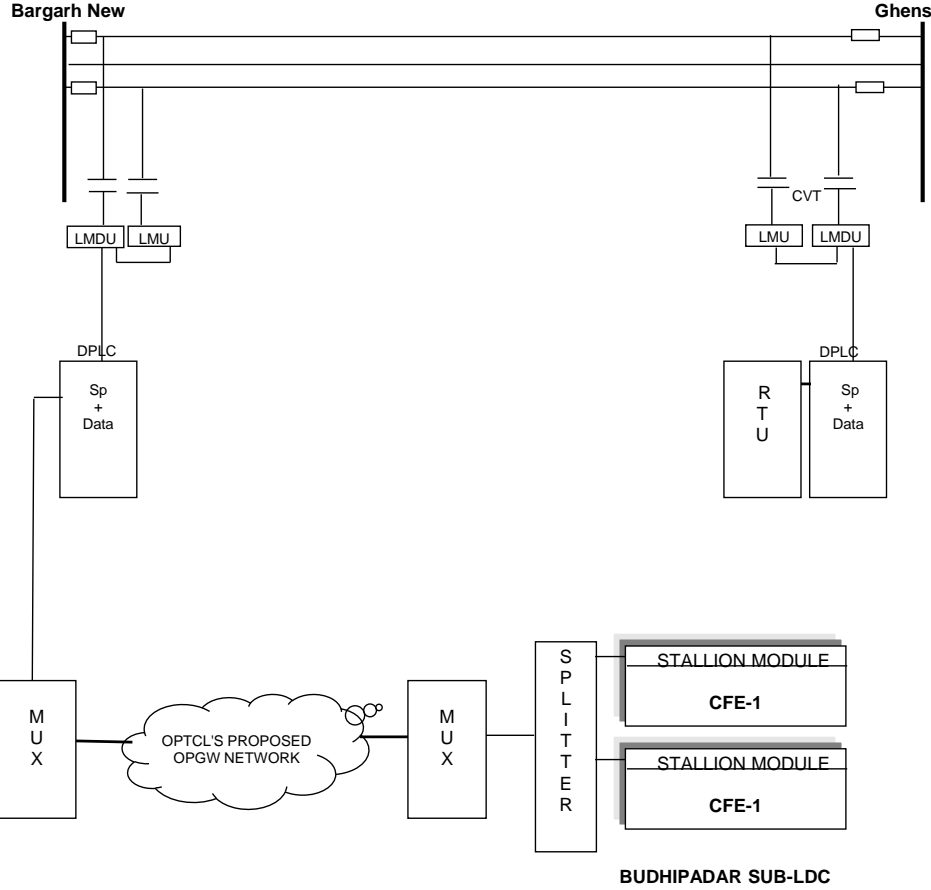


GENERAL MANAGER
TELECOMMUNICATION

SUGGESTED NETWORK CONNECTIVITY FOR FOR SPEECH & DATA APPLICABLE TO 132KV BOLANGIR-SAINITALA LILO AT TUSHRA THROUGH OPGW SCHEME

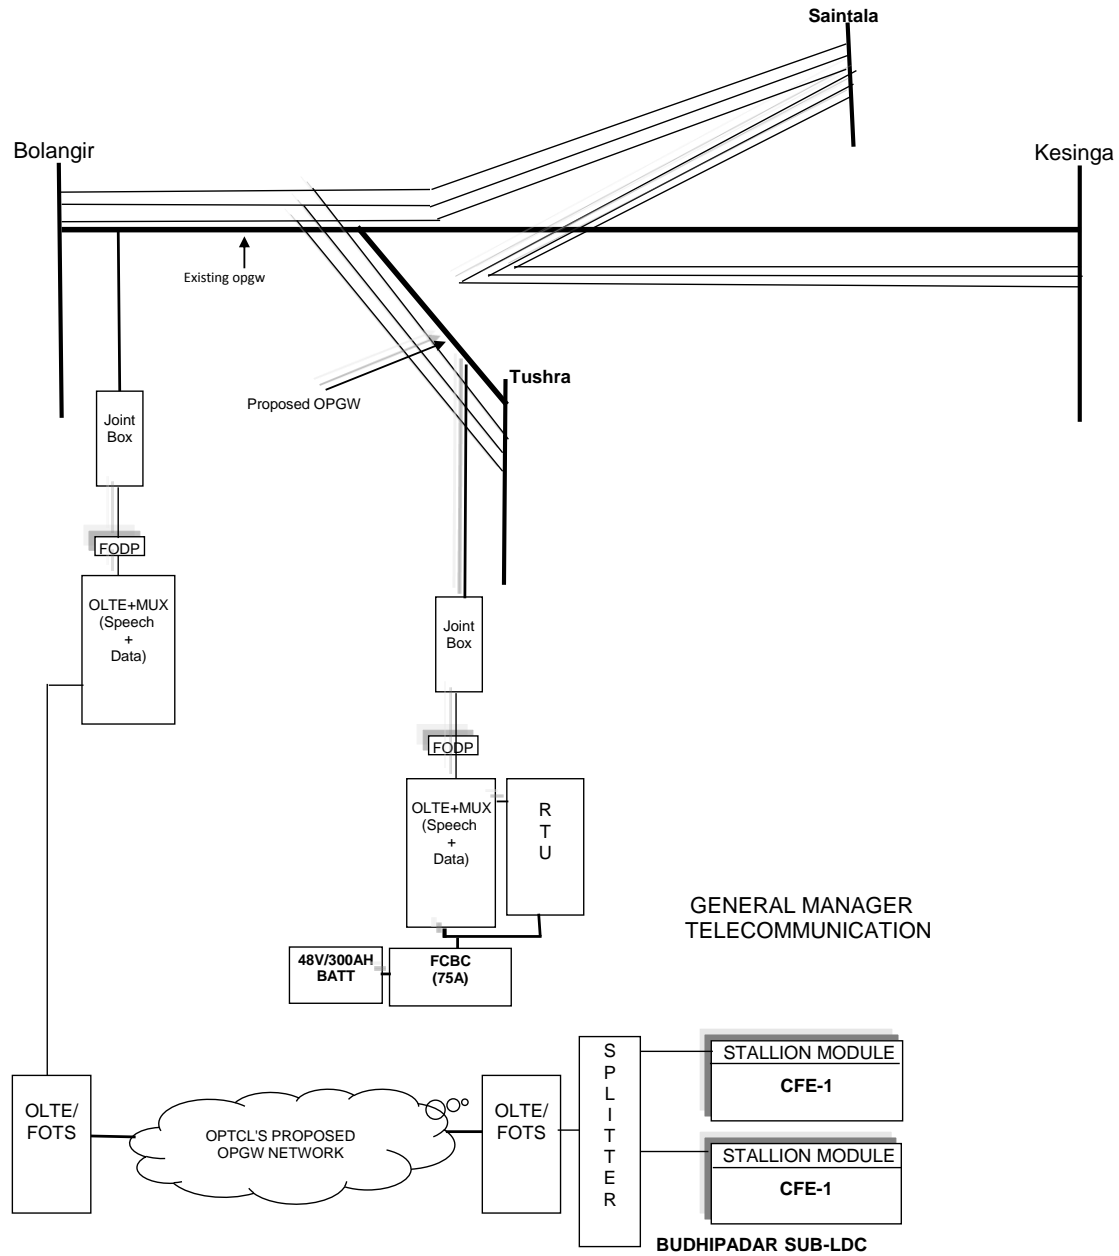

SCHEMATIC LAYOUT FOR PROVISION OF PLCC BETWEEN 132KV KESINGA-JUNAGARH

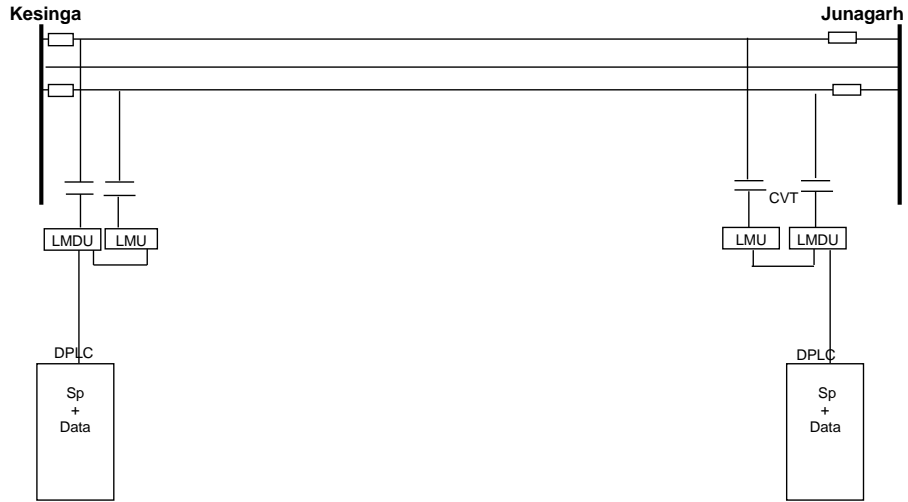

GENERAL MANAGER
TELECOMMUNICATION